


Cyanotoxin Monitoring Requirements

For Sources Determined to be Susceptible

Oregon Health Authority

February 2023

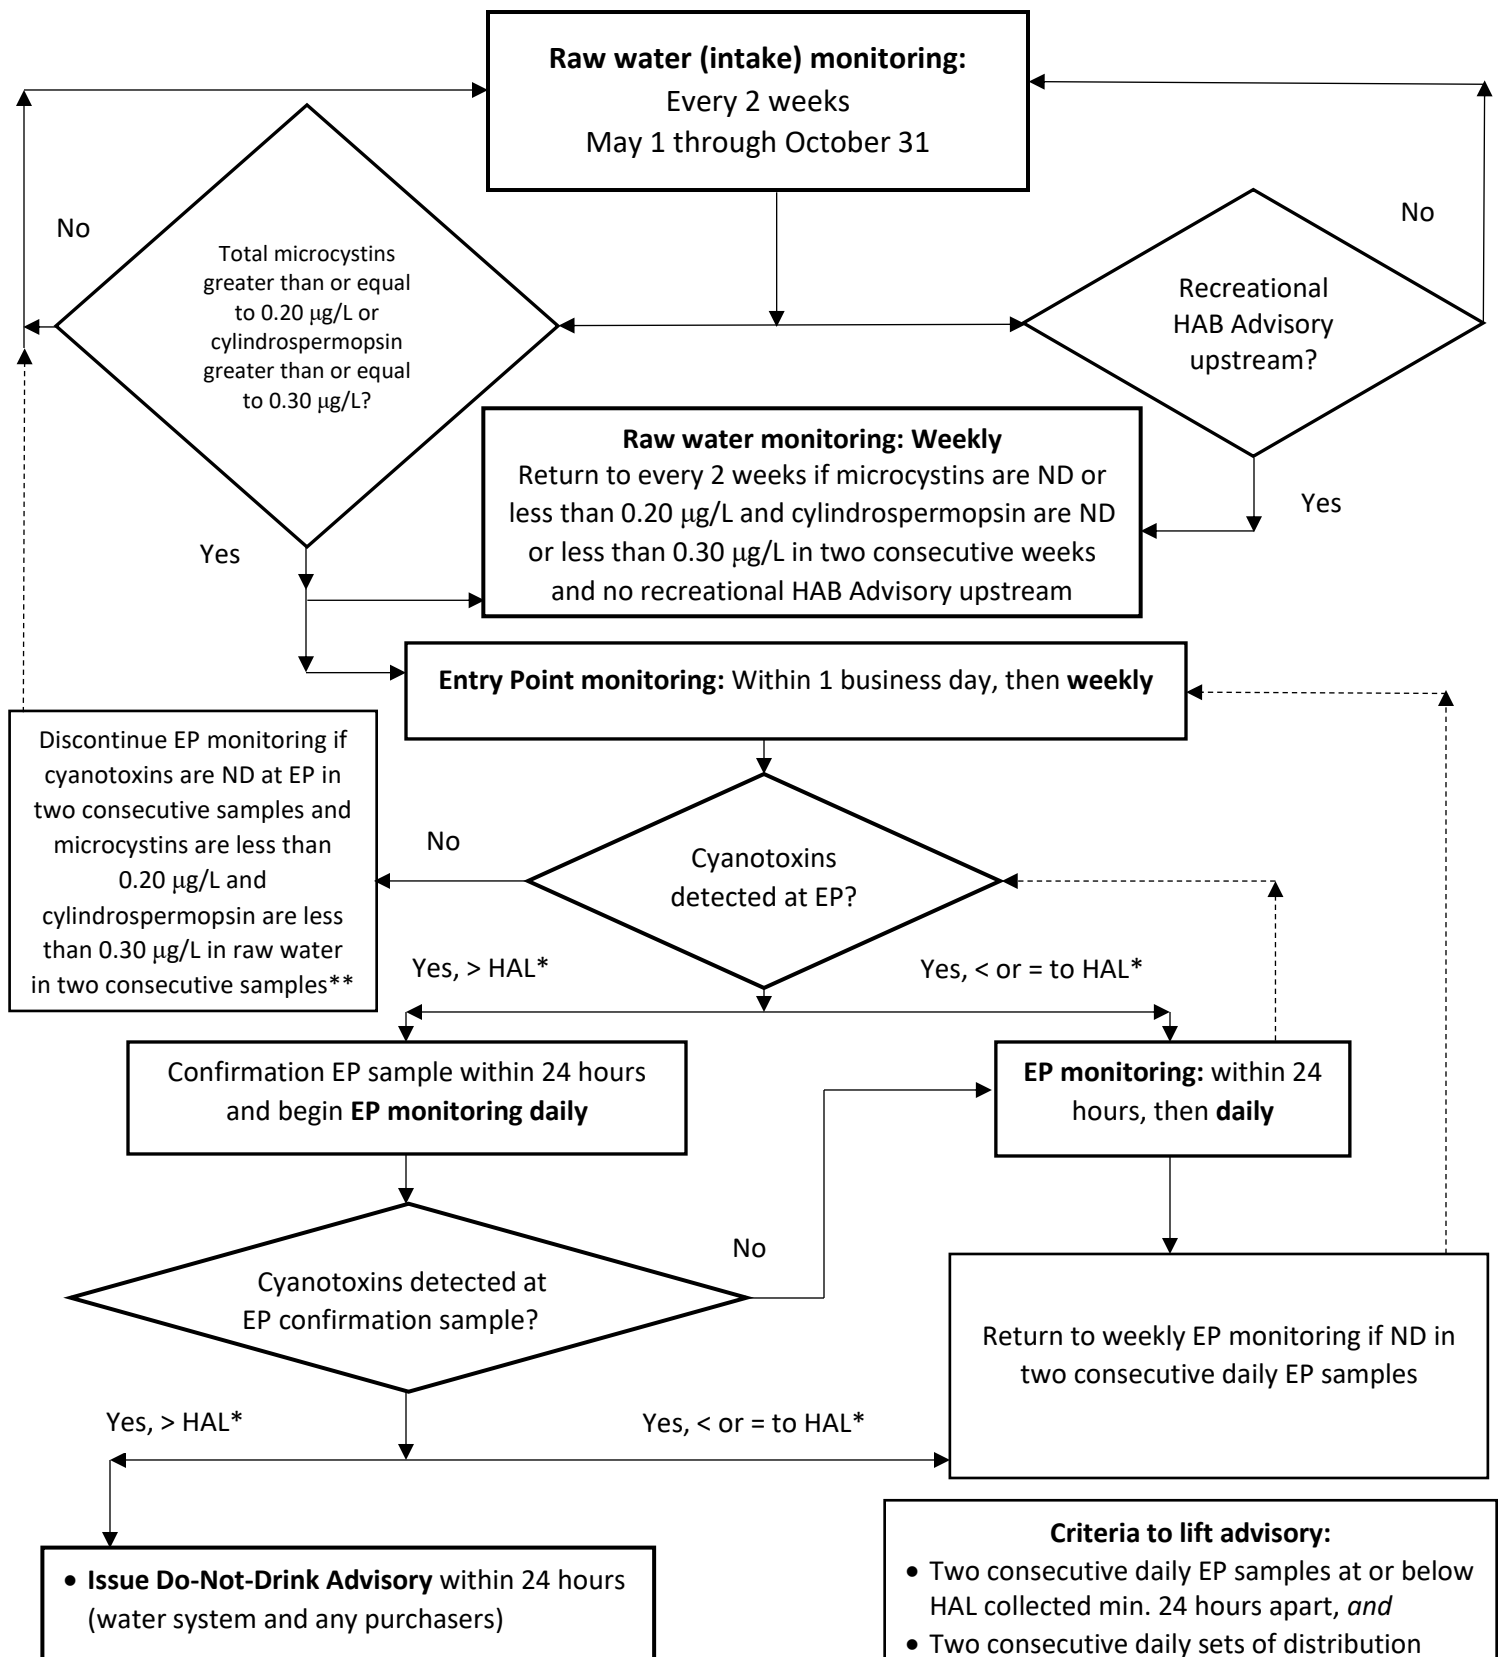

*HAL = Drinking Water Health Advisory Level

**This differs from rule language in OAR 333-061-0540(1)(b)(D). OHA-DWS will follow the language in the box above until rule can be revised. See [Cyanotoxin Rules Fact Sheet](#) for more info.

Criteria to lift advisory:

- Two consecutive daily EP samples at or below HAL collected min. 24 hours apart, *and*
- Two consecutive daily sets of distribution samples at or below HAL collected min. 24 hours apart
- Once lifted, continue applicable raw and EP monitoring